


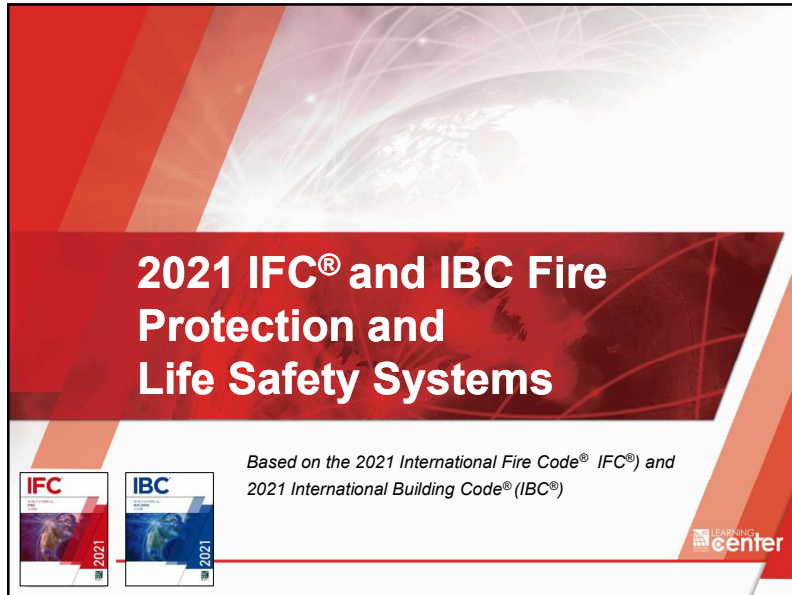


2021 IFC® and IBC Fire Protection and Life Safety Systems

Based on the 2021 International Fire Code® (IFC®) and 2021 International Building Code® (IBC®)

IFC 2021 IBC 2021

LEARNING center

1

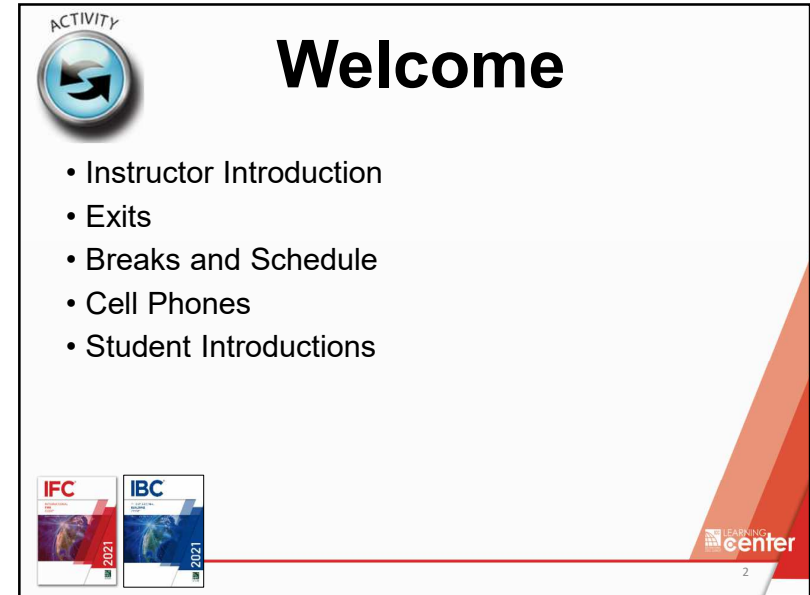

Welcome


ACTIVITY

- Instructor Introduction
- Exits
- Breaks and Schedule
- Cell Phones
- Student Introductions

IFC 2021 IBC 2021

LEARNING center

2

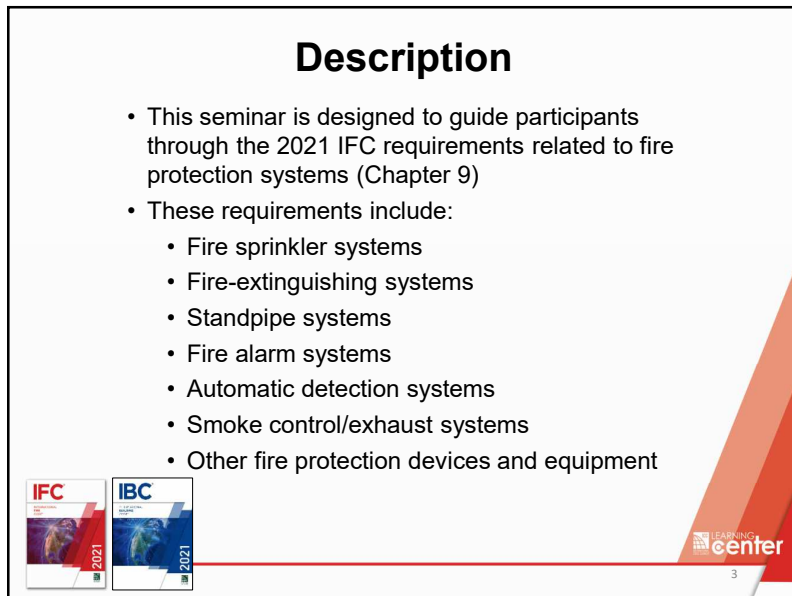

Description

- This seminar is designed to guide participants through the 2021 IFC requirements related to fire protection systems (Chapter 9)
- These requirements include:
 - Fire sprinkler systems
 - Fire-extinguishing systems
 - Standpipe systems
 - Fire alarm systems
 - Automatic detection systems
 - Smoke control/exhaust systems
 - Other fire protection devices and equipment

IFC 2021 IBC 2021

LEARNING center

3



Goal

- Participants will be able to apply key provisions regarding fire protection systems in the 2021 IFC to aid in code application, administration and enforcement

IFC 2021 IBC 2021

LEARNING center

4

Objectives

- Upon completion, participants will be better able to:
 - Define key terms
 - Explain why a fire protection system must conform to code criteria and referenced standards
 - Determine where and when fire protection systems are required
 - Explain the principles of how a fire protection system detects and manages a fire
 - Understand the relationship between the code (IFC/IBC) and the referenced standards



LEARNING center

5

5

Prerequisite Understanding

- Occupancy classifications are based on the use and character of the building
- Many code requirements are based on the occupancy classification



LEARNING center

6

6

Module 1

Fire Protection Systems



LEARNING center

7

7



2021 IFC
§202
Page 2-12

Fire Protection Systems

- **Definition of a Fire Protection System:**
Approved devices, equipment and systems or combinations of systems used to detect a fire, activate an alarm, extinguish or control a fire, control or manage smoke and products of a fire or any combination thereof.
- Given this definition, a fire protection system is required to perform certain functions



LEARNING center

8

8

The IFC's Intent for Fire Protection Systems

- When a fire protection system is required, it is:
 - Designed and constructed in accordance with the applicable NFPA standards
 - Described in the fire protection system design
 - Inspected and maintained in accordance with the IFC and the applicable standards
 - Modified when the hazard changes and the fire protection system is not capable of controlling a fire

• Sprinklers on combustible balconies in multifamily dwellings – §903.3.1.2.1
 • Exempt sprinkler locations – §903.3.1.1.1
 • Limited area sprinkler system – §903.3.8



LEARNING center

9

9

Why the IFC Requires a Fire Protection System

- Fire protection systems are required inside or outside of buildings because of:
 - Occupancy class **Group I-2** fire area or the building
 - Occupancy **Fire area has an OL ≥ 300**
 - Height **Building has a story with OL ≥ 30 and**
 - Storing or using **>100 lbs pyroxylin plastics**
 - Building **Type IIB dry cleaning operation**
 - Type **Spray application of flammable finishes**
 - Fire loss history for specific hazards



LEARNING center

10

10

Chapter 9 Arrangement

- Chapter 9 is divided into 15 sections, including:
 - 901: General
 - 903: Automatic Sprinkler Systems
 - 904: Alternative Fire-extinguishing Systems
 - 905: Standpipe Systems
 - 907: Fire Alarm and Detection Systems
 - 908: Emergency Alarm Systems
 - 909: Smoke Control Systems
 - 910: Smoke and Heat Removal
 - 914: Fire Protection Based on Special Detailed Requirements of Use and Occupancy
 - 915: Carbon Monoxide Detection

IBC Ch 9 is **almost** identical to IFC Ch 9

Some differences occur in §901



LEARNING center

11

11

General Provisions §901

Provision	IFC Section	IBC Section
Construction documents	901.2	–
Permits	901.3	–
Installation	901.4	901.2
Modifications	–	901.3
Threads	–	901.4
Acceptance testing	901.5	901.5
Inspection, testing and maintenance	901.6	901.3
Fire areas	901.4.3	901.7
Pump and riser room size	–	901.8
Systems out of service	901.7	–
Removal of or tampering with equipment	901.8	–
Termination of monitoring service	901.9	–
Recall of fire protection components	901.10	–



LEARNING center

12

12

Construction Documents §901.2

- FCO are authorized to require the submittal, review and approval of design drawings and calculations for fire protection systems
- A contractor's statement of compliance can be required
 - Documents must show that the system complies with the:
 - Plans
 - Applicable standard
 - Manufacturer's instructions



LEARNING center

13

13

Required vs Nonrequired §901.4.1 and §901.4.2

- Required fire protection and life safety systems must comply with the code and the applicable standards
- Nonrequired fire protection and life safety systems must **ALSO** comply with the code and the applicable standards
 - Wherever, any code modification or allowance is made as a result of sprinklers, the system becomes a required system



LEARNING center

14

14

Additional Fire Protection Systems §901.4.4

- Where the FCO deems a hazard to be of a unique nature or unduly difficult for fire department access, additional fire protection features can be required



LEARNING center

15

15

Pump and Riser Room §901.4.7

- Pump room or riser room is not required, but, if provided, they must have adequate room for service
 - Following manufacturer's specifications
- Ability to remove largest piece of equipment and reinstall



LEARNING center

16


16

- Access
- Marking on Access Doors
 - Approved Sign
 - Min height – 2"
 - Min Stroke width – ½ in
- Environment
 - $\geq 40^{\circ}\text{F}$
- Lighting



17

- Must meet NFPA 20 requirements
- Pump room maintained >40°F
- Cables and circuits protected by 2-HR construction or UL 2196
- IBC §913.2.1: 1-HR separation, 2-HR in high-rise, or ≥50'
- Class II fuel supply is not included in MAQ if it meets IFC §605.4.2.2

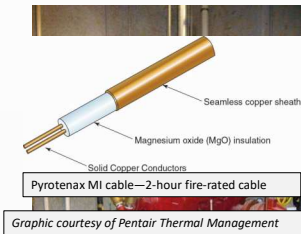

- ≤660 gallon
- ≤3,000 gallon if in PAST and room is sprinklered



18

- Before a fire protection system can be approved it must be tested
- Fire protection systems must be accepted and approved based on the applicable NFPA fire protection system standards



Photo courtesy of Protection Development Inc.



19

19

- Fire protection system impairment is a critical event that must be reported to the FCO
- Impairment of fire protection systems requires:
 - An individual be designated as the impairment coordinator
 - A plan of action for the impairment

[illegible]

- Impairment coordinator:
 - Responsible for all work
 - Notify FD of the status
 - Ensure system is restored



20

20

Important Terms

- Two important definitions must be reviewed and understood
- Several thresholds for requirements are based on these definitions
 - Level of exit discharge (LED)
 - Fire area



LEARNING center

21

21



2021 IFC
§202
Page 2-10

Level of Exit Discharge

- Definition of Level of Exit Discharge :
The story at the point at which an exit terminates and an exit discharge begins.
- A building can have more than one level of exit discharge




LEARNING center

22

22

Level of Exit Discharge

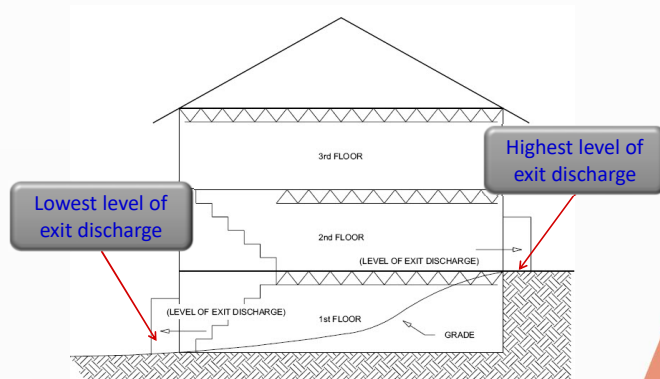

LEARNING center

23

23

23



2021 IFC
§202
Page 2-12

Fire Area

- Definition of Fire Area:
The aggregate floor area enclosed and bounded by *fire walls, fire barriers, exterior walls or horizontal assemblies* of a building. Areas of the building not provided with surrounding walls shall be included in the fire area if such areas are included within the horizontal projection of the roof or floor next above.




LEARNING center

24

24

24

Fire Area Bounded by Exterior Walls

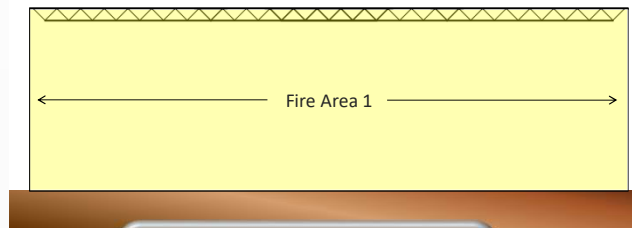

A building constructed with or without fire-resistant materials or assemblies is a fire area




LEARNING center

25

25

Fire Area Compartmentalized Using Fire Barriers

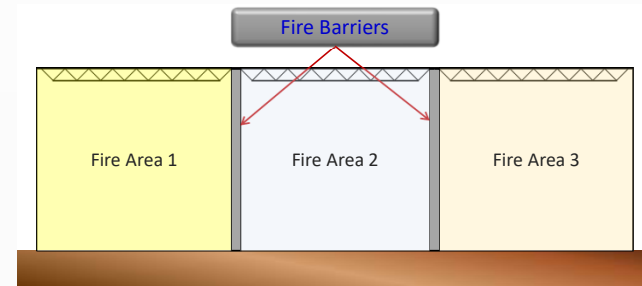

A building divided using fire-resistant assemblies can have one or more fire areas




LEARNING center

26

26

Fire Areas in Multistory Buildings

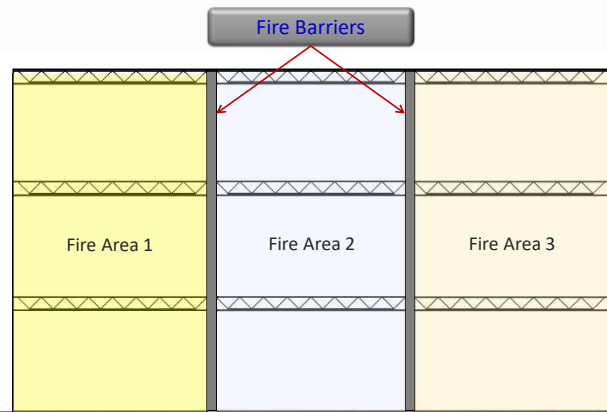


LEARNING center

27

27

Fire Areas in Multistory Buildings

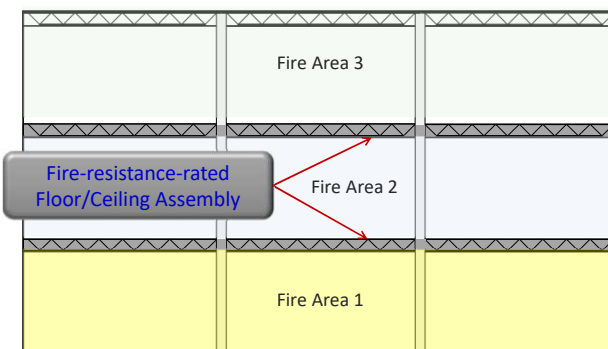


LEARNING center

28

28


Fire Areas - Using a Fire Wall

- Fire walls can divide a structure into ≥ 2 buildings
- Each building becomes its own fire area
- Each building can be further subdivided with fire barriers

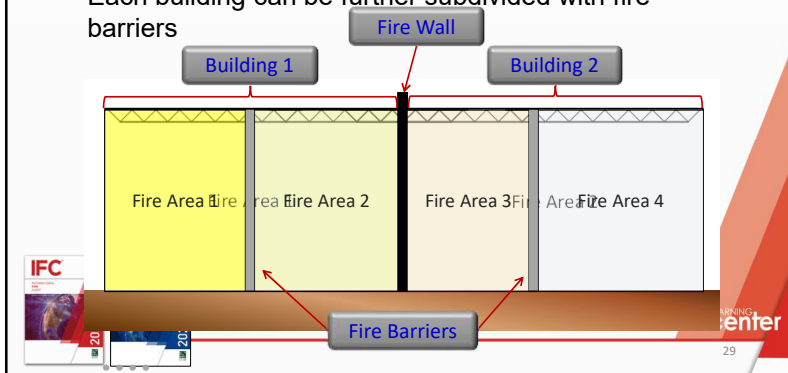

29

How Many Fire Areas?

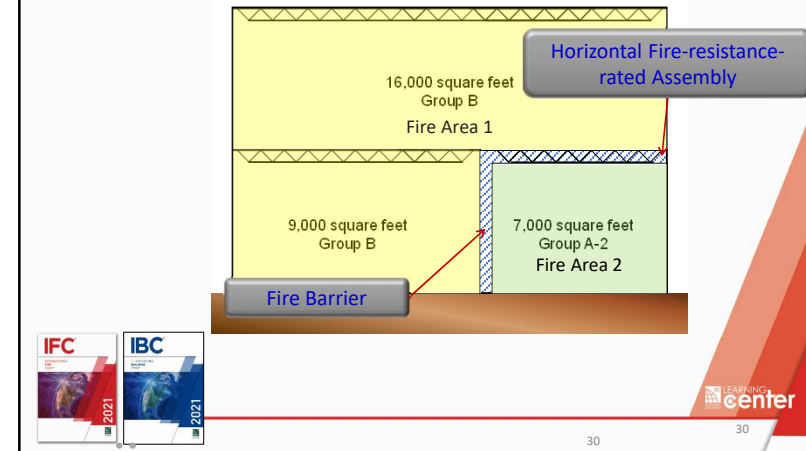


30



Fire Area Application IFC §901.4.4, IBC §901.7

- **Fire areas.** Where buildings, or portions thereof, are divided into *fire areas* so as not to exceed the limits established for requiring a *fire protection system* in accordance with this chapter, such *fire areas* shall be separated by *fire barriers* constructed in accordance with §707 of the IBC or *horizontal assemblies* constructed in accordance with §711 of the IBC, or both, having a fire-resistance rating of not less than that determined in accordance with §707.3.10 of the *International Building Code*.

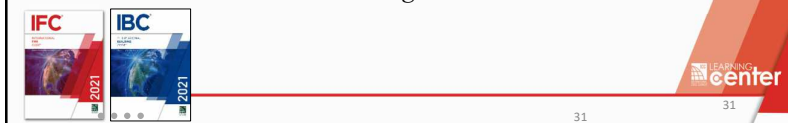

31




IBC Table 707.3.10

Fire-resistance Rating Requirements for Fire Barrier Assemblies or Horizontal Assemblies Between Fire Areas

OCCUPANCY GROUP	FIRE-RESISTANCE RATING (hours)
H-1, H-2	4
F-1, H-3, S-1	3
A, B, E, F-2, H-4, H-5, I, M, R, S-2	2
U	1

NOTE: a fire area must be at least 1-HR fire-resistance-rated construction
But in most cases, 1-HR is not adequate

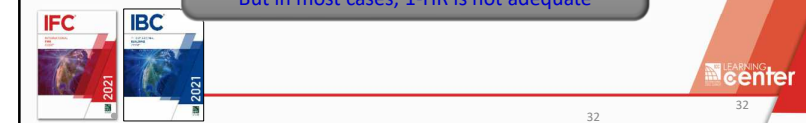

32

REFER TO
2021 IBC
Table 508.4
Page 5-13
CODE BOOK

IBC Table 508.4

Required Separation of Occupancies (hours)

Occupancy Group	A, E	I-1, I-3, I-4	I-2	R ^a	F-2, S-2 ^b , U	B ^c , F-1, M, S-1	H-1	H-2	H-3, H-4	H-5
	S	NS	S	NS	S	NS	S	NS	S	NS
A, E	N	N	1	2	2	NP	1	2	N	1
I-1 ^a , I-3, I-4	1	2	N	N	2	NP	1	NP	1	2
I-2	2	NP	2	NP	N	2	NP	2	NP	2
R ^a	1	2	1	NP	2	NP	N	1 ^c	2 ^c	1
F-2, S-2 ^b , U	N	1	1	2	2	NP	1	2	N	N
B ^c , F-1, M, S-1	1	2	1	2	2	NP	1	2	1	2
H-1	NP	NP	NP	NP	NP	NP	NP	NP	NP	NP
H-2	2	4	3	NP	3	NP	3	NP	3	4
H-3, H-4	2	3	2	NP	2	NP	2	NP	2	3
H-5	2	NP	2	NP	2	NP	2	NP	2	NP

33

33

REFER TO
2021 IBC
Table 706.4
Page 7-10
CODE BOOK

IBC Table 706.4

Fire Wall Fire-resistance Ratings

GROUP	FIRE-RESISTANCE RATING (hours)
A, B, E, H-4, I, R-1, R-2, U	3 ^a
F-1, H-3 ^b , H-5, M, S-1	3
H-1, H-2	4 ^b
F-2, R-3, R-4, S-2	2

a. In Type II or V construction, walls shall be permitted to have a 2-hour fire-resistance rating.

b. For Group H-1, H-2 or H-3 buildings, also see Sections 415.7 and 415.8

34

34

Design and Installation Requirements

§903.3

- Before reviewing the IFC requirements for fire sprinkler systems, it is important to understand:
 - The various standards applicable to fire sprinkler system design
 - The relationship between the code and the standard



LEARNING center

35

35

Design and Installation Requirements

§903.3

- NFPA publishes 3 standards governing the design, installation, testing and maintenance of fire sprinkler systems:
 - §903.3.1.1 – NFPA 13, *Installation of Sprinkler Systems*
 - §903.3.1.2 – NFPA 13R, *Installation of Sprinkler Systems in Low-Rise Residential Occupancies*
 - §903.3.1.3 – NFPA 13D, *Sprinkler Systems for One- and Two-Family Dwellings and Manufactured Homes*



LEARNING center

36

36

Application Matrix of the Sprinkler Design Standards

System Feature	Sprinkler Standard		
	NFPA 13	NFPA 13R	NFPA 13D or IRC §P2904
Extent of Protection	Throughout the building	Occupied spaces	Occupied spaces
Design Intent	Life Safety & Property Protection	Life Safety	Life Safety
Applicability	All Occupancies	Group R up to 4-stories or 60'	1- & 2-family dwellings & Townhomes
Design Methods	Pipe schedule; Control mode – discharge density/design area; Control mode – specific application; Suppression mode	4 sprinklers per compartment	2 sprinklers per compartment
Sprinklers	All listed & approved types	Listed Residential	Listed Residential
Minimum H ₂ O Supply Duration	30 to 120 minutes	30 Minutes	7 or 10 Minutes

37

“Installed Throughout”

- IFC Table 1017.2 *Exit Access Travel Distance*, Footnote c
 - Buildings equipped throughout with an automatic sprinkler system in accordance with §903.3.1.1.
- IFC Table 5003.1.1(1) *MAQ per Control Area*, Note d
 - Maximum allowable quantities shall be increased 100 percent in buildings equipped throughout with an approved automatic sprinkler system in accordance with §903.3.1.1.
- IBC Table 506.2 *Allowable Area*, Note S1
 - S1 = Buildings a maximum of one story above grade plane equipped throughout with an automatic sprinkler system installed in accordance with §903.3.1.1.

What does
“equipped throughout” or
“installed throughout” mean?

38

“Installed Throughout”

- IFC Table 1017.2 *Exit Access Travel Distance*, Footnote c
 - Buildings equipped throughout with an automatic sprinkler system in accordance with §903.3.1.1.
- IFC Table 5003.1.1(1) *MAQ per Control Area*, Note d
 - Maximum allowable quantities shall be increased 100 percent in buildings equipped throughout with an approved automatic sprinkler system in accordance with §903.3.1.1.
- IBC Table 506.2 *Allowable Area*, Note S1
 - S1 = Buildings a maximum of one story above grade plane equipped throughout with an automatic sprinkler system installed in accordance with §903.3.1.1.

What does
“equipped throughout” or
“installed throughout” mean?

39

“Installed Throughout”

- Under the design of NFPA 13, are **all** areas in the building protected with sprinklers?
 - NO
 - Attic spaces <6" high
 - Ceased spaces without combustible construction
 - Under the design of NFPA 13D, are all areas protected with sprinklers?
 - NO
 - Attic spaces without fuel-fired equipment
 - Small bathrooms
- So which design provides for fire sprinklers “installed throughout”?
- Attic spaces with noncombustible wall covering
 - Small closets with noncombustible wall covering

40

“Installed Throughout”

• §903.3.1.1 states:

Where the provisions of this code require that a building or portion thereof be equipped throughout with an automatic sprinkler system in accordance with this section, sprinklers shall be installed throughout in accordance with NFPA 13 except as provided in Sections 903.3.1.1.1 and 903.3.1.1.2.

“Installed throughout” means that sprinklers are installed throughout the building in all locations as required by the design standard and the code



LEARNING center

41


41

“Installed Throughout”

903.3.1.1.1 Exempt locations. Automatic sprinklers shall not be required in the following rooms or areas where such rooms or areas are protected with an approved automatic fire detection system in accordance with §907.2 that will respond to visible or invisible particles of combustion. Sprinklers shall not be omitted from a room merely because it is damp, of fire-resistance-rated construction or contains electrical equipment.

1. A room where the application of water or flame and water constitutes a hazard.
2. A room where the application of water or flame and water constitutes a hazard.
3. General storage areas.
4. Rooms where the application of water or flame and water constitutes a hazard.
5. Fire alarm control rooms.
6. Machine rooms associated with occupant evacuation elevators designed in accordance with §3008 of the IBC.

• These provisions are not found in NFPA 13
• These provisions are less restrictive than NFPA 13
• §102.7.1 – code provisions take precedence over the standard



LEARNING center

42

42



Fire Protection Systems

Given: 89,000 ft² Group S-1 warehouse. The fire sprinkler system was designed to protect rack storage of Class III commodities in double row racks 24' high. The original tenant moved out of the building and the new tenant is storing Class IV commodities.

- What section would apply to ensure the automatic sprinkler system is adequately protecting these new commodities?

§901.4



LEARNING center

43

43



Fire Protection Systems

- Is an anhydrous ammonia detection system in a refrigeration machinery room a fire protection system?

NO
§202 Definition of “Fire Protection System”

- Which of the following wall assemblies is **not** a method to separate fire areas?
 - Fire wall
 - Fire partition
 - Fire barrier
 - Horizontal assembly



LEARNING center

44

44

Module 2



Automatic Sprinkler Systems





45

Automatic Sprinkler Systems

- NFPA 13 recognizes 4 types of sprinkler systems:
 - Wet-pipe sprinkler system
 - Dry-pipe sprinkler system
 - Pre-action sprinkler system
 - Deluge sprinkler system

These systems are designed for use inside buildings with temperatures $\leq 40^{\circ}\text{F}$

Water does not enter system until activation of detection device and sprinkler

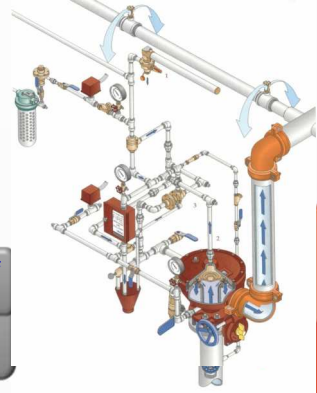

Graphic courtesy of Viking Corp.




46

Allowed Increases Based on Fire Sprinkler Systems

Code Section	Modification	NFPA 13	NFPA 13R	NFPA 13D
IBC 504.3 & 504.4	Building Height	Yes	No	No
IBC 506.2	Building Area	Yes	No	No
IBC 507.4, 507.5 & 507.7	Unlimited building area for certain occupancies	Yes	No	No
IFC 503.1.1	Increased distance from building to FD access road	Yes	Yes	Yes
IFC 507.5.1	Hydrant spacing increased to 600'	Yes	Yes	No
IFC 1017.2	Exit access travel distance	Yes	Yes	No
IFC Table 5003.1.1(1) & (2)	100% increase in MAQ for certain hazardous materials	Yes	No	No
IFC Table 5003.11.1	100% increase in the MAQ for nonflammable solid and nonflammable and noncombustible liquid hazardous materials in Group M & S	Yes	No	No
IFC Table 5704.3.4.1	100% increase in the MAQ for flammable and combustible liquids in Group M & S	Yes	No	No




47

Allowed Reductions Based on Fire Sprinkler Systems

Code Section	Modification	NFPA 13	NFPA 13R	NFPA 13D
IBC 403.2.1	Reduction in shaft rating in high-rise buildings	Yes	No	No
IBC 404.2	Decorations in, and use of, atriums	Yes	No	No
IBC Table 508.4	Separation of occupancies	Yes	No	No
IBC 705.8.5	Vertical separation of openings	Yes	Yes	No
IBC 708.3	Fire-resistance rating of fire partitions	Yes	No	No
IBC 708.4.2	Draftstopping in attics of Group R-1 & R-2	Yes	Yes	No
IFC Table 803.3	Reduction in flame spread rating for interior finish	Yes	Yes	No
IFC 907.2	Manual fire alarm boxes in Group A, B, E, F, M, R-1, R-2 & R-4	Yes	Yes	No
IFC 1007.1.1	Separation of exits	Yes	Yes	No
IFC Table 1020.1	Corridor walls in means of egress	Yes	Yes	No
IFC 1028.1	Exit discharge	Yes	Yes	No
IFC Table B105.1(1)	50% reduction in fire flow for Group R-3 & R-4 and 1- and 2-family dwellings	Yes	Yes	Yes
IFC Table B105.2	75% reduction in fire flow	Yes	Yes	Yes




48

Design Criteria in NFPA 13

- Pipe schedule method
- Control mode – density/design area method
 - This includes residential and quick-response sprinklers
- Control mode – specific application method
 - These designs are generally limited to storage applications or special sprinklers
- Suppression mode method
 - Limited to Early Suppression Fast-Response (ESFR) sprinklers



LEARNING center

49

49

Types of Sprinklers

- NFPA 13 recognizes several different types of sprinklers configured for upright, pendent or sidewall installation
 - Early Suppression Fast-Response (ESFR)
 - Extended Coverage
 - Quick-Response Extended Coverage
 - Quick-Response (QR)
 - Residential
 - Standard Spray
 - Special
 - Specific Application Control Mode



LEARNING center

50

50

Special Sprinklers NFPA 13 §8.4.8

- Special sprinklers have been evaluated & listed for performance in specific conditions:
 - Fire tests related to the intended hazard
 - Spray pattern distribution with respect to obstructions and wetting of walls and floors
 - Evaluation of the sprinkler's thermal sensitivity
 - Sprinkler performance under horizontal or sloped ceilings
 - Area of design
 - Allowable clearance to ceilings



LEARNING center

51

51

Automatic Fire Sprinklers Data Sheet

- Sprinkler data sheets generally contain:
 - Sprinkler selection criteria for residential, light hazard, ordinary hazard, extra hazard, special designs and storage applications
 - Minimum design pressure
 - Minimum or maximum clearances from the sprinkler to the hazard
 - Installation requirements based on the selected sprinkler
 - The SIN (Sprinkler Identification Number)



LEARNING center

52

52

Manufacturer Data Sheet



TECHNICAL DATA

**MICROMATIC® STANDARD
RESPONSE UPRIGHT
SPRINKLER VK100 (K5.6)**

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION

The Viking Micromatic® Standard Response Upright VK100 Sprinkler is a small, thermostatic, glass-bulb spray sprinkler available in several different finishes and temperature ratings to meet design requirements. The special Polyester and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive atmospheres and are listed/approved as corrosion resistant as indicated in the Approval Charts. (Note: FM Global approves the ENT coating as corrosion resistant. FM Global has no approval classification for Polyester coatings as corrosion resistant.) Viking standard response sprinklers may be ordered and/or used as open sprinklers (glass bulb and pip cap assembly removed) on deluge systems. Refer to Ordering Instructions.




2. LISTINGS AND APPROVALS

cULus Listed: Category VNI/V
FM Approved: Classes 2001, 2002, 2015, 2017, 2043

NOTE: Other International approval certificates are available upon request. Refer to Approval Chart 1 and UL Design Criteria on pages cULus Listing requirements, and refer to Approval Chart 2 and FM Design Criteria for FM Approval requirements that must be followed.

53

Manufacturer Data Sheet



TECHNICAL DATA

**MICROMATIC® STANDARD
RESPONSE UPRIGHT
SPRINKLER VK100 (K5.6)**

3. TECHNICAL DATA

Specifications:

- Minimum Operating Pressure: 7 psi (0.5 bar)
- Maximum Working Pressure: 175 psi (12 bar) WWP
- Factory tested hydraulically to 345 psi (24 bar)
- Thread size: 1/2" NPT, 15 mm BSP
- Nominal K-Factor: 5.6 U.S. (80.6 metric)
- Glass-bulb fluid temperature rated to -65°F (-55°C)
- Overall Length: 2-3/8" (60 mm)

cULus Listing: FM Approval and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

** Metric K-factor measurement shown is in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Material Standards:

- Frame Casting: Brass UNS-C84400 or QM Brass
- Deflector: Brass UNS-C23000 or Copper UNS-C19500
- Bulb: Glass, nominal 5 mm diameter
- Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape
- Screw: Brass UNS-C36000
- Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400

For Polyester Coated Sprinklers: Belleville Spring-Exposed
For ENT coated Sprinklers: Belleville Spring - Exposed, Screw and Pipcap - ENT plated.

†† Not for FM Approval.

Ordering Information: (Also refer to the current Viking price list.)

Order Micromatic® Standard Response Upright VK100 by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.

Finish Suffix: Brass = A, Chrome = F, White Polyester = M-W, Black Polyester = M-B, Wax Coated = C, Wax Over Polyester = V-W, ENT = JN

Temperature Suffix: 135 °F (57 °C) = A, 155 °F (68 °C) = B, 175 °F (79 °C) = D, 200 °F (93 °C) = E, 212 °F (100 °C) = M, 286 °F (141 °C) = G, 360 °F (182 °C) = H, 500 °F (260 °C) = L, OPEN = Z (PTFE only).

For example, sprinkler VK100 with a 1/2" thread, Brass finish and a 155 °F (68 °C) temperature rating = Part No. 12986AB

54

Manufacturer Data Sheet



TECHNICAL DATA

**MICROMATIC® STANDARD
RESPONSE UPRIGHT
SPRINKLER VK100 (K5.6)**

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating ¹	Maximum Ambient Ceiling Temperature ²	Bulb Color
Ordinary	135 °F (57 °C)	100 °F (38 °C)	Orange
Ordinary	155 °F (68 °C)	100 °F (38 °C)	Red
Intermediate	175 °F (79 °C)	150 °F (65 °C)	Yellow
Intermediate	200 °F (93 °C)	150 °F (65 °C)	Green
High	286 °F (141 °C)	225 °F (107 °C)	Blue
Extra High	360 °F (182 °C)	300 °F (149 °C)	Mauve
Ultra High ³	500 °F (260 °C)	465 °F (240 °C)	Black

Sprinkler Finishes: Brass, Chrome, White Polyester, Black Polyester, and ENT.
Corrosion-Resistant Coatings: White Polyester, Black Polyester, and Black PTFE in all temperature ratings. ENT in all temperature ratings except 135 °F (57 °C). Wax-Coated Brass and Wax over Polyester⁴ for sprinklers with the following temperature ratings: 155 °F (68 °C) Lt. Brown Wax, 175 °F (79 °C) Brown Wax, 200 °F (93 °C) Brown Wax, 286 °F (141 °C) Dk. Brown Wax⁵

55

Manufacturer Data Sheet



TECHNICAL DATA

**MICROMATIC® STANDARD
RESPONSE UPRIGHT
SPRINKLER VK100 (K5.6)**

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 1 (UL)

Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Sprinkler Base Part	SIN	Thread Size	Nominal K-Factor	Overall Length	Listings and Approvals ¹ (Refer also to UL Design Criteria.)
DESIGN CRITERIA - UL (Also refer to Approval Chart 1.)					

cULus Listing Requirements:

The Viking Micromatic® Standard Response Upright Sprinkler VK100 is cULus Listed as indicated in Approval Chart 1 for installation in accordance with the latest edition of NFPA 13 for standard spray sprinklers.

- Designed for use in Light, Ordinary, and Extra Hazard occupancies.
- The sprinkler installation rules contained in NFPA 13 for standard spray upright sprinklers must be followed.

IMPORTANT: Always refer to Bulletin Form No. F-091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, LPCB, APSAD, Vds or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

56

Manufacturer Data Sheet

VIKING TECHNICAL DATA MICROMATIC® STANDARD RESPONSE UPRIGHT SPRINKLER VK100 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)
Micromatic® Standard Response Upright Sprinkler VK100
Maximum 175 PSI (12 bar) WWP

Temperature KEY
F: 175°F (79°C)
A1X: Exclusion (if applicable)

Sprinkler Base Thread Size Nominal K-Factor Overall Length FM Approvals

DESIGN CRITERIA - FM
(Also refer to Approval Chart 2.)

FM Approval Requirements:
The Viking Micromatic® Standard Response Upright Sprinkler VK100 is FM Approved as standard response Non-Storage upright sprinkler as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0). FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.
NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

IMPORTANT: Always refer to Bulletin Form No. F-091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

IFC 2021 IBC 2021 LEARNING center

57

Automatic Sprinkler Systems

- Does IBC/IFC §1020.4 allow an increase the length of a dead-end corridor in a Group R-1 occupancy when an NFPA 13R automatic fire sprinkler system is installed?

NO
Only NFPA 13 system, even in Group R
§1020.4

- What prescriptive method of design is permitted for the design of an automatic sprinkler system?

Pipe schedule

58

Automatic Sprinkler Systems

- What is RTI and what range of RTI is required for a sprinkler to be either fast response, quick response or residential?

RTI = Response Time Index
RTI of 50 – 80

- What type of fire sprinkler system is designed for all sprinklers to flow simultaneously?

Deluge sprinkler system

59

Module 3



Sprinkler Systems Requirements

60

Required Fire Sprinklers

- Fire sprinklers requirements are based on:

- Occupancy classification
- Size of fire area containing a specific occupancy
- Occupant load in a specific occupancy
- Floor level of the specific occupancy
- Specific operation occurring in the building
- Modification of other code requirements

Group H-5

Group F-1 fire area
>12,000 ft²

Group A-2 with OL ≥100

Group A-3 on a level other
than the LED

High-piled storage

Height/Area
Travel distance
Haz Mat quantities

LEARNING center

61

61

Fire Sprinkler System Installation

- The area to be protected by sprinklers is dependent on the occupancy classification

Occupancy Classification	Fire Area	Occupancy	Entire Floor ¹	Entire Building
A-1, A-2, A-3, A-4				
A-5				
B Ambulatory Care Facility				
F				
H-1, H-2				
H-3				
I				
M				
R				X
S	X			X

¹ The fire sprinkler system is installed on² Fire sprinklers are required in concession areas and other areas where woodworking occurs with an area of 2,501-12,000 ft²

Bottom line – read the code requirements carefully



LEARNING center

62

62

Fire Sprinklers in Group A

- Where fire sprinklers are required in a Group A occupancy located on a story other than LED, fire sprinklers must be installed on all stories leading to all levels of exit discharge that are used by the Group A occupancy

§903.2.1.1, 903.2.1.2,
903.2.1.3, 903.2.1.4.

Automatic sprinkler
system installed on
story with Group AAutomatic sprinkler
system installed on all
stories to all LED

LEARNING center

63

63

Group A-1 §903.2.1.1

- Fire sprinklers required and throughout all stories from the Group A-1 occupancy to and including the levels of exit discharge serving that occupancy where one of the following conditions exists:
 - Fire area >12,000 ft²
 - Fire area has an OL ≥300
 - Fire area is located on a level other than LED
 - Fire area contains a multi-theater complex



LEARNING center

64

64

Group A-2 §903.2.1.2

- Fire sprinklers required and throughout all stories from the Group A-2 occupancy to and including the levels of exit discharge serving that occupancy where one of the following conditions exists:

- Fire area >5,000 ft²
- Fire area has an OL ≥100
- Fire area is located on a level other than LED



LEARNING center


65

65

Group A-3 & A-4 §903.2.1.3, §903.2.1.4

- Fire sprinklers required and throughout all stories from the Group A-3, A-4 occupancy to and including the levels of exit discharge serving that occupancy where one of the following conditions exist:

- Fire area >12,000 ft²
- Fire area has OL ≥300
- Fire area is located on a level other than LED



LEARNING center


66

66

Group A-5 §903.2.1.5

- Fire sprinklers required in the following areas in excess of 1,000 ft² that are accessory to stadiums or arenas:

- Concession areas
- Retail areas
- Press boxes

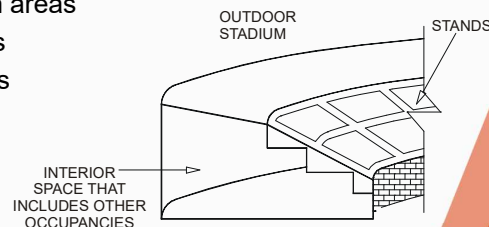


LEARNING center

67

67

Group A-5 §903.2.1.5.1

- **903.2.1.5.1 Spaces under grandstands or bleachers.**
- Enclosed spaces under *grandstands* or *bleachers* shall be equipped with an *automatic sprinkler system* in accordance with Section 903.3.1.1 where either of the following exist:
 1. The enclosed area is 1,000 square feet (93 m²) or less and is not constructed in accordance with Section 1029.1.1.1.
 2. The enclosed area exceeds 1,000 square feet (93 m²).

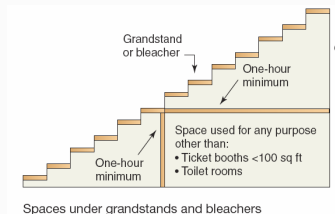


LEARNING center

68

68

Assembly Occupancies on Roofs §903.2.1.6

- Fire sprinklers are required on all floors between an occupied roof and the LED discharge where assembly uses occur on the rooftop and:
- OL >100 for Group A-2, or
- OL >300 for other Group A occupancies

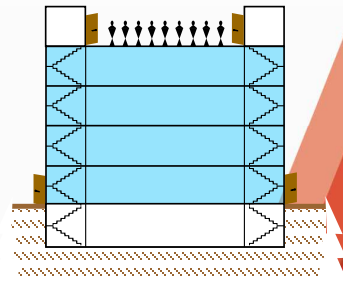


LEARNING center

69

69

Multiple Group A Fire Areas §903.2.1.7

- Sprinklers required where multiple fire areas contain Group A-1, A-2, A-3 or A-4 occupancies that share egress components and OL ≥300

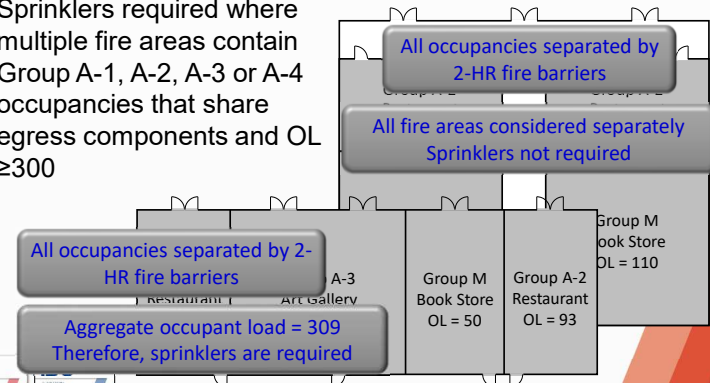

LEARNING center

70

70

Ambulatory Care Facilities §903.2.2



How do you determine the number of care recipients?

Count the beds

- Fire sprinklers required on floors with a Group B Ambulatory Care Facility when:
 - ≥4 care recipients incapable of self-preservation
 - ≥1 care recipients incapable of self-preservation on a floor other than LED

§903.3.2 requires the installation of QR or residential sprinklers throughout smoke compartments containing treatment rooms



LEARNING center

71

71

Ambulatory Care Facilities §903.2.2



- In buildings where ambulatory care is provided on levels other than the *level of exit discharge*, an *automatic sprinkler system* shall be installed throughout the entire floor as well as all floors below where such care is provided, and all floors between the level of ambulatory care and the nearest *level of exit discharge*, the *level of exit discharge*, and all floors below the *level of exit discharge*.
- Exception:** Floors classified as an open parking garage are not required to be sprinklered.



LEARNING center

72

72

Group E §903.2.3

- Fire sprinklers required in the occupancy when one of the following conditions exist:
 1. Fire area >12,000 ft²
 2. All portions below LED
 - Sprinklers **not** required in areas below LED where each classroom has at least one exterior exit door at ground level
 3. The Group E occupancy has a dead-end load of ≥ 300



LEARNING center

73

73

Group F-1 §903.2.4

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area >12,000 ft²
 - Fire area is >3 stories above grade
 - Aggregate fire areas >24,000 ft²
 - Used for manufacture of upholstered furniture or mattresses >2,500 ft²



LEARNING center

74

74

Woodworking Operations §903.2.4.1

- Fire sprinklers required throughout the building where **both** of the following conditions exist:
 - Fire area >2,500 ft²
 - The process generates finely divided waste or uses finely divided combustible materials



LEARNING center

75

75

Group H §903.2.5

- Fire sprinklers required in all Group H occupancies
- §5004.5 requires systems to meet Ordinary Hazard Group 2 criteria, at minimum with 3,000 ft² design area
 - 0.17 gpm/ft²
 - Many materials require more water



- Flammable & combustible liquids
- Flammable & pyrophoric gases
- Level 2 & 3 aerosols
- Organic peroxides
- Oxidizers



LEARNING center

76

76

Group H-5 §903.2.5.2

- Fire sprinklers required throughout the building
- IFC Table 903.2.5.2 establishes minimum design criteria for automatic sprinklers based on the location in the building



LEARNING center

77

77

Group I §903.2.6

- Fire sprinklers required throughout the building
- §903.2.6 allows the installation of NFPA 13R systems in Group I-1 Condition 1
- §903.3.2 requires the installation of QR or residential sprinklers in:
 - All areas of smoke compartments containing care recipient sleeping units in Group I-2
 - Sleeping units in Group I-1



LEARNING center

78

78

Group M §903.2.7

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area >12,000 ft²
 - Fire area >3 stories above grade
 - Aggregate fire areas >24,000 ft²
 - Used for display and sale of upholstered furniture or mattresses >5,000 ft²



LEARNING center

79

79

Group R §903.2.8

- Fire sprinklers required throughout the building for all Group I occupancies
- NFPA 13D systems in Group R-3, R-4 Condition 1 and care facilities with ≤5 clients
- NFPA 13R systems in Group R-4 Condition 2
- §903.3.2 requires the installation of QR or residential sprinklers in dwelling units and sleeping

1- & 2-family dwellings and townhomes built under the IRC are sprinklered in accordance with the IRC or NFPA 13D



80

80

Pedestal/Podium Construction IBC §510.4

- Group R occupancies with parking beneath
- Depending on the construction and the building's height and area, the design of the sprinkler system may be based on NFPA 13, 13R or a combination of NFPA 13 and 13R




LEARNING
center

81

81

Pedestal/Podium Construction

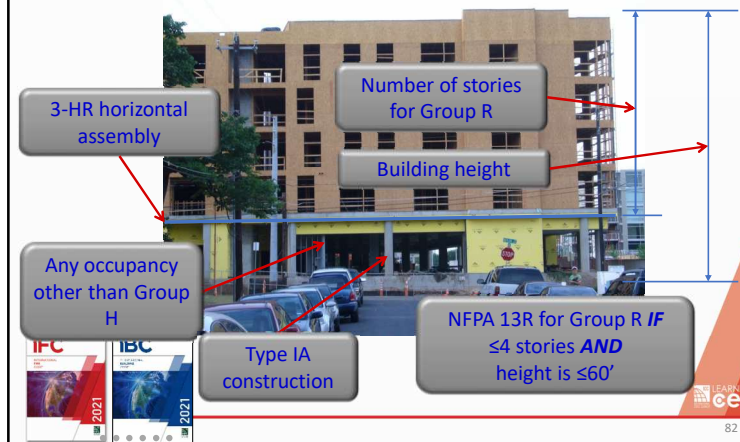

LEARNING
center

82

82

Pedestal/Podium Construction



LEARNING
center

83

83

Group S-1 §903.2.9

- Fire sprinklers required throughout the building where one of the following conditions exist:
 - Fire area >12,000 ft²
 - Fire area is >3 stories above grade
 - Aggregate fire areas >24,000 ft²
 - Used for storage of upholstered furniture or mattresses >2,500 ft²
 - The storage of commercial trucks or buses when the fire area is >5,000 ft²



LEARNING
center

84

84

Group S-1 Repair Garages §903.2.9.1

- Fire sprinklers required throughout the building when one of the following conditions exist:
 - Building is 1 story **and** fire area >12,000 ft²
 - Building is ≥ 2 stories **and** fire area >10,000 ft²
 - Repair garage is located in a basement
 - Repair garage for commercial trucks or buses and the fire area is >5,000 ft²




LEARNING center

85

85

Group S-1 Storage of Tires §903.2.9.2

- Fire sprinklers required when:
 - Fire area >20,000 cubic feet

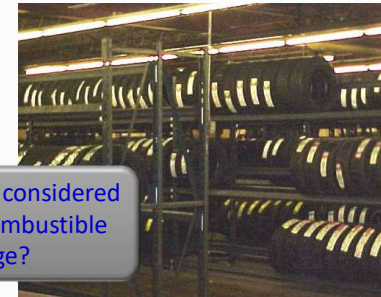

Would this be considered high-piled combustible storage?



LEARNING center

86

86

Group S-2 Enclosed Parking Garage §903.2.10

- Fire sprinklers required when :
 - Fire area >12,000 ft²
 - Parking garage is located beneath another occupancy



LEARNING center

87

87

Basements and Stories without Openings §903.2.11.1

- Fire sprinklers required on every story, including basements, where floor area >1,500 ft² **UNLESS**:
 - Openings are provided on at least wall with 1 opening within each 50' of wall, and
 - Openings are separated ≤50'
 - Travel distance to exterior openings ≤75'
 - Each opening has minimum dimension ≥30"




- Frequently applied to basements
- Also applies to above grade stories

LEARNING center

88

88


Basements and Stories without Openings §903.2.11.1

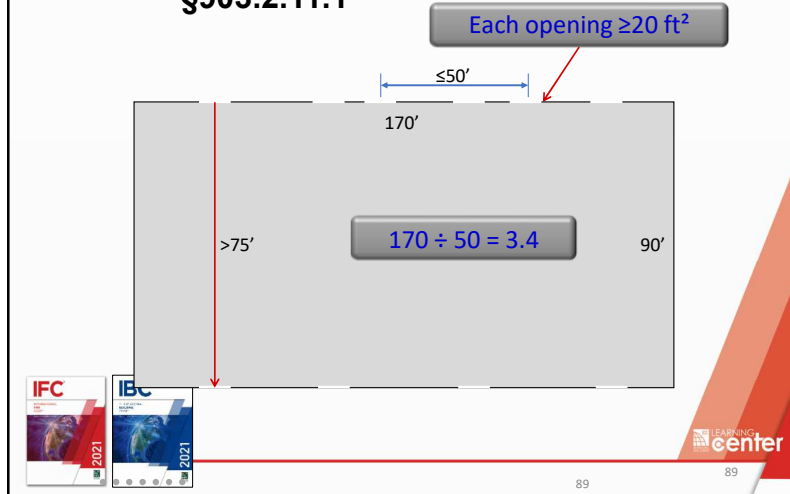

89

Buildings $\geq 55'$ in Height §903.2.11.3

- Fire sprinklers required in buildings having a story $\geq 55'$ above the LLFDVA with OL ≥ 30

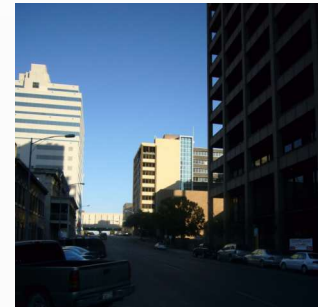

90

Other Hazards §903.2.11.4

- Fire sprinkler required in hazardous exhaust ducts with a diameter $\geq 10"$
- If used for conveying a corrosive atmosphere, sprinklers must be listed for the atmosphere
- Listed flexible hose sprinklers are special sprinklers with pressure & flow calculated in accordance with NFPA 13, §11.2.3.4.3




Photograph courtesy of Flexhead Inc.

91

Balconies and Decks §903.3.1.2.1


- Addition to NFPA 13R
- Fire sprinklers required on balconies, decks and patios in Type V construction with a roof or deck above
- The sprinklers must be installed 1" – 6" below a structural member and $\leq 14"$ below the deck above

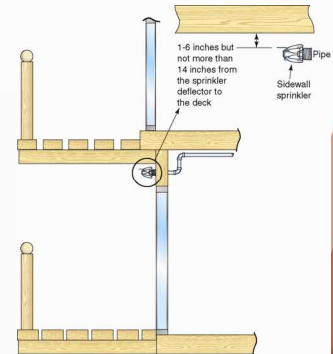

92

Balconies and Decks §903.3.1.2.1

- Exterior balconies, decks and ground floor patios of dwelling units and sleeping units are constructed in accordance with Section 705.2.3.1, Exception 3 of the *International Building Code*.

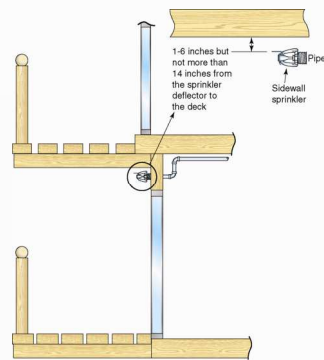

LEARNING center

93

93

Sprinkler Protection of Group R Attic Spaces §903.3.1.2.3



In buildings of Type III, IV or V construction that are designed under the special provisions for pedestal buildings, attics not otherwise required to be sprinklered are now further regulated if the roof assembly is located more than 55 feet above the lowest level of fire department vehicle access. Where such a pedestal building condition exists, the attics shall be:

Provided with sprinkler protection, or Constructed using noncombustible construction, or Constructed using fire-retardant-treated wood, or Filled with noncombustible insulation. The required conditions are generally consistent with those previously established for Group R-4, Condition 2 occupancies.



LEARNING center

94

94

Sprinkler System Supervision §903.4

- Water-flow switches, pressure switches and valves that control the water supply for a fire sprinkler system must be electrically supervised
- 7 exceptions

- 1- & 2-family dwellings
- Limited area sprinkler systems
- NFPA 13R sprinkler systems with a common supply for both domestic and sprinkler water with no shutoff
- Jockey pump control valves
- Control valves sealed or locked in the open position
- Valves controlling the fuel supply
- Trim valves sealed or locked in the open position



LEARNING center

95

95

Sprinkler System Alarm Signals §903.4.1

- Alarm signals must be sent to:
 - Supervising station, or
 - Constantly attended location



Photo courtesy of Property Protection Inc.



LEARNING center

96

96

Sprinkler Systems §903.4

- An approved audible device shall be provided for each sprinkler system and located on the exterior of the building
- Floor control valves are on each riser on each floor in high-rise buildings



center
97

97

Fire Department Connection §912

- Street side of building
- 3' access around FDC
- Location approved by FCO
- Approved fit
- Labeled
- Visible from OR signs di



center
98

98



Automatic Sprinkler Requirements

- How many patients must be rendered incapable of self-preservation before an automatic sprinkler system is required in an ambulatory care facility located on the grade plane of a building?

4

§903.2.2



LEARNING
center
99

99



Automatic Sprinkler Requirements

2. Which of the following occupancy groups does not require automatic sprinkler protection throughout a building regardless of size?

- A. Group S-1
- B. Group R-2
- C. Group H-5
- D. Group I-2



LEARNING
center
100

100

ACTIVITY

Automatic Sprinkler Requirements

3. T F When sprinklers are required to be installed throughout the entire building, this means that the system must be designed to NFPA 13.

4. What is the minimum sprinkler discharge density and design area for a Group H-4 occupancy?

Ordinary Hazard Group 2 over 3,000 ft²
§5004.5



LEARNING center

101

Module 4



Automatic Fire Extinguishing Systems



LEARNING center

102

Fire-extinguishing Systems §904

- The following suppression types of fire-extinguishing systems are recognized:
 - Dry chemical
 - Wet chemical
 - Carbon Dioxide (CO₂)
 - Halon
 - Clean agent
 - Aqueous film forming foam
 - Water mist



LEARNING center

103

Flammable Liquid Containment Dike AFFF Flooding System



Photo courtesy of International Code Consultants, Inc.



LEARNING center

104

Design and Acceptance Testing Considerations for AFES


- Is the selected agent compatible with the hazard being protected?
- Is the system pre-engineered or an engineered design?
- Is the system a local application or total flooding design?
- If applicable, what is the integrity of the enclosure as it relates to air movement and infiltration?
- Is the amount of agent adequate to protect the largest hazard?



105

105

CO2 Automatic Fire-extinguishing System

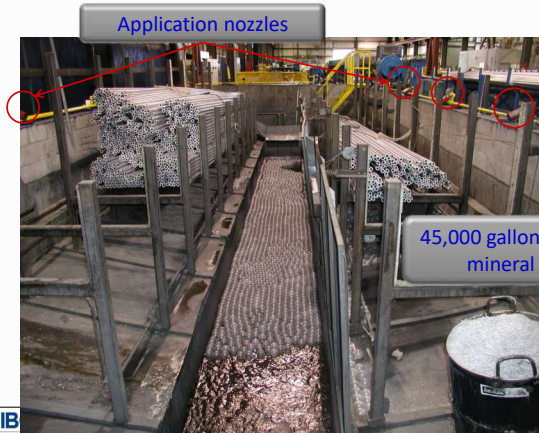

106

106

106



2021 IFC
§904.2
§904.2.1
Page 9-12

Fire-extinguishing Systems §904.2

904.2 Where permitted. Automatic fire-extinguishing systems installed as an alternative to the required automatic sprinkler systems of Section 903 shall be approved by the fire code official.

904.2.1 Restriction on using automatic sprinkler system exceptions or reductions. Automatic fire-extinguishing systems shall not be considered alternatives for the purposes of exceptions or reductions allowed for automatic sprinkler systems or by other requirements of this code.



107

107

107

Installation Requirements for Automatic Fire-extinguishing Systems

- Systems must be designed to automatically activate
- For agents which pose a health hazard, alarm signals shall warn occupants when the system is in the process of beginning to discharge
- For buildings also equipped with a fire alarm system, the AFES must be monitored by the fire alarm system
- Where the AFES system requires notification devices, they must be audible and visual



108

108

Inspection and Testing of Automatic Fire-extinguishing Systems

- Prior to an acceptance test, the following elements to be inspected:
 - Confirm the design is consistent with the hazard being protected
 - Placement and location of detection devices, discharge nozzles, alarms and manual means of activation
 - Signs and operating instructions for the system



LEARNING center

109

109

Dry-chemical Fire-extinguishing Systems

- Dry-chemical AFES can be engineered or pre-engineered fire suppression systems designed to protect a specific hazard or can be used for total flooding protection applications



- Flammable and combustible liquids
- Flammable gases
- Combustible solids, such as plastics and ordinary combustibles

6-month inspection and testing of:

- Detection and releasing devices
- Alarms (where required)
- Verification that a sufficient volume of agent is available for the protected hazard



LEARNING center

110

110

Carbon Dioxide (CO₂) Fire-extinguishing Systems

- CO₂ systems can be designed for local application, total flooding or hand hoselines using NFPA 12
- Systems can be engineered or pre-engineered
- Inspected and tested every 6 months
- High-pressure cylinders must be weighed every 6 months to ensure a sufficient amount of agent is available
- Hoses and auxiliary equipment must be inspected annually



LEARNING center

111

111

Halon Fire-extinguishing Systems

- Manufacturing of halons has been prohibited in the U.S. since 1994
 - Halons are chlorinated or fluorinated hydrocarbons
 - Excellent extinguishing agents
 - Ozone-depleting chemicals
- New systems using existing stockpiles of halon are permitted
- Inspected annually including cylinders, hoses and releasing components
 - Hoses require a test every 5 years

Montreal Protocol



LEARNING center

112

112

Clean Agent Fire-extinguishing System


- A Clean Agent is defined as an “Electrically nonconducting, volatile or gaseous fire-extinguishant agent that does not leave a residue upon evaporation.”
- Clean agents are available in two formulations:
 - Halocarbons – formulated from organic compounds and fluorine, chlorine, bromine or iodine
 - Inert gas – formulated from nitrogen, argon, helium or neon. CO₂ may be used as a secondary agent
- All of the agents are liquefied compressed gases



113

113

Typical Design for a Clean Agent System Protecting a Computer Room

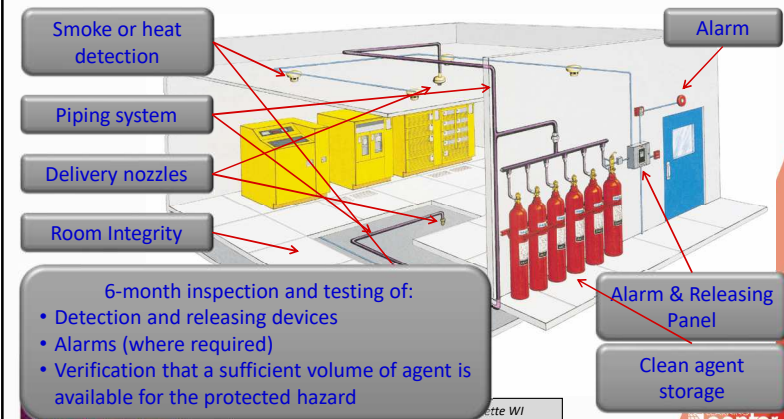

114

Water Mist Fire Protection Systems §904.11

- Systems designed in accordance with NFPA 750
- The systems are either pre-engineered or engine-driven
- Water limited second

NFPA 750 §3.3.19: A water spray for which the $Dv0.99$, for the flow-weighted cumulative volumetric distribution of water droplets, is less than 1,000 microns at the minimum design operating pressure of the water mist nozzle.



115

115

Water Mist Fire Protection Systems

- 5-outlet water mist fire-extinguishing system designed to protect engine test cells



116

116

Water Mist Fire Protection Systems

- Water mist test on a hydrocarbon pool fire



Photograph courtesy of Securiplex LLC



LEARNING center

117

117

Commercial Cooking Systems §904.12

- Commercial cooking systems shall be protected using:
 - Wet chemical listed to UL 300; or
 - Dry chemical listed to UL 300; or
 - Automatic sprinkler system listed for this application
- These systems must be installed in accordance with their listing and the manufacturer's installation instructions



Photo courtesy of Ansul Incorporated



LEARNING center

118

118



2021 IFC
§202
Page 2-6

Commercial Cooking Appliances

- Commercial cooking appliances defined:
Appliances used in a commercial food service establishment for heating or cooking food and which produce grease vapors, steam, fumes, smoke or odors that are required to be removed through a local exhaust ventilation system. Such appliances include deep fat fryers, upright broilers, griddles, broilers, steam-jacketed kettles, hot-top ranges, under-fired broilers (charbroilers), ovens, barbecues, rotisseries, and similar appliances. For the purpose of this definition, a food service establishment shall include any building or a portion thereof used for the preparation and serving of food.



LEARNING center

119

119

Wet-Chemical Fire-extinguishing Systems

- These systems are installed in accordance with NFPA 17A, *Wet Chemical Extinguishing Systems*
- These systems must be listed to UL 300, *Fire Testing of Fire Extinguishing Systems for Protection of Restaurant Cooking Areas*



LEARNING center

120

120

Wet-Chemical Fire-extinguishing Systems

- Wet-chemical fire-extinguishing system protecting a Type I single island cooking hood




LEARNING center

121

121

Wet-Chemical Fire Extinguishing System

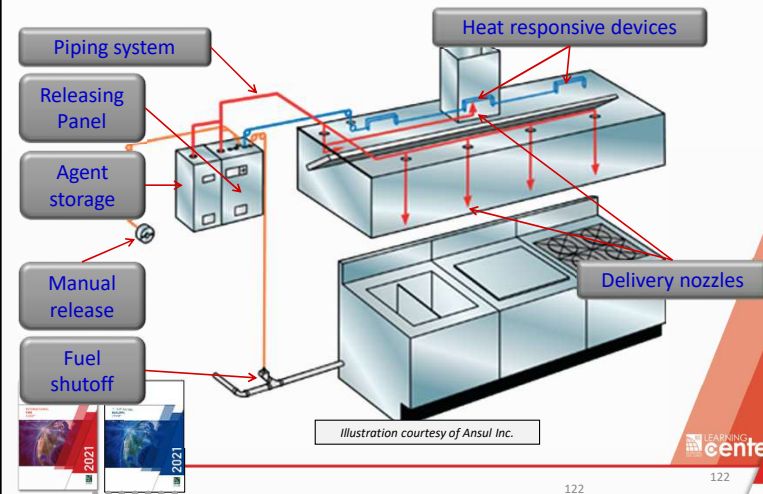

LEARNING center

122

122

Inspection of Commercial Hoods

Table 607.3.3.1
Commercial Cooking System Inspection Frequency

Type Of Cooking Operation	Frequency of Inspection
High-volume cooking operations such as 24-hour cooking, charbroiling or wok cooking	3 months
Low-volume cooking operations such as places of religious worship, seasonal businesses and senior centers	12 months
Cooking operations utilizing solid-fuel burning cooking appliances	1 month
All other cooking operations	6 months



Photo courtesy of Flue Steam, Inc.



LEARNING center

123

123

Portable Fire Extinguishers for Commercial Cooking Operations

- §906.4.2 requires portable fire extinguishers for commercial cooking systems
 - Listed Type K extinguisher
 - Travel distance $\leq 30'$
 - Solid fuel appliances
 - One 2.5 gallon, or two 1.5 gallon
 - Deep fat fryers
 - One 1.5 gallon for 4 fryers, ≤ 80 lbs each
 - See manufacturer's instructions for fryers $> 6 \text{ ft}^2$



Photo courtesy of Amerex Inc.



LEARNING center


124

124

ACTIVITY

Fire-extinguishing Systems

- Can a dry-chemical fire-extinguishing system be used to increase the allowable height of a building?
NO
§904.2.1
- How often must frangible bulb fusible links in a Type I hood be replaced?
After activation
§904.12.5.3, Exception



125

125

ACTIVITY

Fire-extinguishing Systems

3. Which alternative fire-extinguishing agent does not leave residue once it evaporates?

- a. Dry chemical
- b. Wet chemical
- c. Aqueous film forming foam
- d. Clean agent



126

126

ACTIVITY

Fire-extinguishing Systems

4. What type of portable fire extinguisher is required for the protection of commercial cooking operations?

- a. Class B
- b. Class C
- c. Class D
- d. Class K



127

127

ACTIVITY

Fire-extinguishing Systems

4. What type of portable fire extinguisher is required for the protection of commercial cooking operations?

- a. Class B
- b. Class C
- c. Class D
- d. Class K



128

128

Module 5



Standpipe Systems




129

Standpipe Systems §905.3.1

- Standpipes required in:
 - ≥ 4 above or below grade plane.
 - Buildings with a floor level $>30'$ above LLFDVA
 - Buildings with a floor level $>30'$ below HLFDVA
 - Group A with OL $>1,000$
 - Covered & open malls
 - Stages $>1,000$ ft²
 - Underground buildings
 - Marinas and boatyards




130

Standpipe Systems §202

- Standpipes are classified as follows:
 - Class I: designed for FD use only
 - Class II: designed for use by building occupants
 - Class III: designed for use by FD or building occupants

2½" hose connections

1½" hose connections with hose and nozzle

Combination of 2½" connections PLUS 1½" hose connections with hose and nozzle





131

Location of Class I Hose Valves §905.4

- In stair shafts, hose valves are required at main floor landings unless otherwise approved by the FCO
- On each side of a horizontal exit
- Adjacent to each public entrance to the mall and adjacent to each entrance from an exit passageway or exit corridor

Hose valves not required when $\leq 130'$ from an exit stairway hose connection

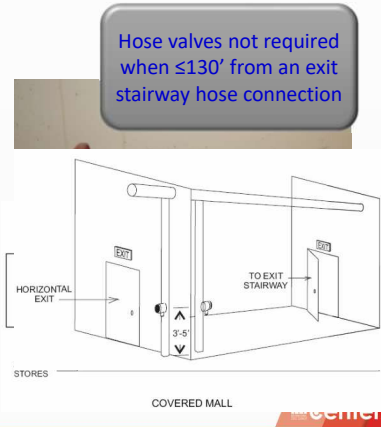




132

Interconnection of Standpipes §905.4.2, §905.6.2

- Where ≥ 2 Class I or III standpipes are in the same building or area they must be interconnected
- NFPA 14 requires interconnection of standpipes at the top of the building when the water supply or tank is at the top

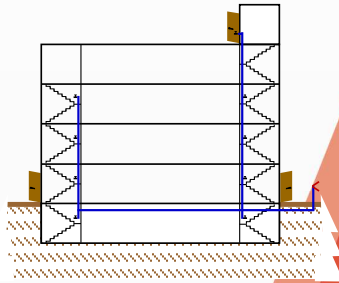

LEARNING center
133

133

Location of Class II Hose Connections §905.5

- Where Class II standpipe system is required throughout building, hose and valves must be accessible and distributed so all portions of the building are $\leq 100'$ hose with $30'$ hose stream
- Hose stations required in Group A-1 & A-2 occupancies with OL $> 1,000$
 - Each side of stage
 - At rear of auditorium
 - Each side of balconies
 - Each tier of dressing rooms




LEARNING center
134

134

Class III Standpipe at Stages

- Class III wet standpipe required at stages $> 1,000$ ft²
- In sprinklered buildings, hose and nozzle is not required

Stage is a space in a building utilized for entertainment or presentations, and includes overhead hanging curtains, drops, scenery or stage effects other than lighting and sound.

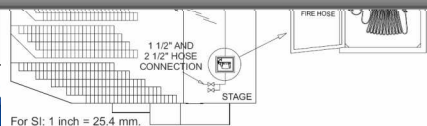

LEARNING center
135

135

Module 6



Fire Alarm and Detection Systems



LEARNING center

136

Purpose of a Fire Alarm and Detection System

A fire alarm and detection system can be designed to perform several functions:

- Providing notification of an emergency
- Monitoring and notification of supervisory and trouble signals
- Alerting the occupants
- Summoning aid
- Controlling fire safety functions



Photo courtesy of
Siemens Building Systems Inc.



137

137

Fundamental Components of a Fire Alarm and Detection System

• Fire Alarm Control Unit

Receives inputs from automatic and manual fire alarm devices and may be capable of supplying power to detection devices and transponders or off-premises transmitters. The control unit may be capable of providing a transfer of power to the notification appliances and transfer of condition to relays or devices.




138

138

Fire Alarm Systems Requirements §907.2

- Must comply with NFPA 72, *National Fire Alarm Code*
- All components must be listed and approved
- Design audibility level must be shown on plans
- Where fire detection is required, smoke detection is 1st choice
- Where heat detection is required, fire sprinklers can substitute for heat detectors



139

139

Group A §907.2.1

- Manual fire alarm system required where $OL \geq 300$

Group A-1, A-2, A-3 and A-4 will all require a fire sprinkler system when $OL \geq 300$



alarm boxes can be eliminated on

When a required fire alarm system is installed in a building, ALL fire-extinguishing systems shall be monitored by FACU §904.3.5



140

140

Group A §907.2.1.1

- Emergency voice/alarm communication system is required in Group A with $OL \geq 1,000$
- This system must be connected to a source of emergency power



141

141

Group B §907.2.2

- Manual fire alarm required where:
 - $OL \geq 500$
 - ≥ 100 persons are located above or below LED
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location




142

142

Group B Ambulatory Care Facility §907.2.2.1

- Manual fire alarm system required throughout the fire area containing an ACF
 - In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location
- Smoke detection system required in ACF and all public areas including corridors and lobbies
 - Smoke detection can be eliminated in sprinklered buildings



143

143

Group E §907.2.3

- Manual fire alarm system required where $OL \geq 50$
- Emergency voice/alarm communication system required where $OL > 100$
- Manual fire alarm boxes are not required where:
 - Interior corridors are protected by smoke detectors
 - Smoke or heat detection is provided in auditoriums, cafeterias and gyms
- Manual fire alarm boxes are not required where:
 - Building is sprinklered and EVAC will activate upon waterflow



144

144

Group F §907.2.4

- Manual fire alarm required where:
 - ≥ 2 stories in height
 - OL ≥ 500 above or below the lowest LED
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location



LEARNING
center

145

145

Group H §907.2.5

- Manual fire alarm required in:
 - Group H-5
 - Group H-2 or H-3 that manufacture organic coatings
- Smoke detection system required where storing
 - Highly toxic gases
 - Organic peroxides
 - Oxidizers



LEARNING
center

146

146

Group I §907.2.6

- Manual fire alarm system required in all Group I
 - Manual fire alarm boxes are permitted to be located at constantly attended locations, as long as travel distances are maintained
- Smoke detection system shall be installed in corridors and waiting areas open to corridors Group I-1
 - Smoke detection not required in sprinklered Group I-1 Condition 1



LEARNING
center

147

147

Group I-2 Condition 1 §907.2.6.2

- In addition to manual system, smoke detection is required in corridors and areas open to corridors
 - Corridor detection not required where sleeping units have smoke detectors that notify at nursing station
 - Corridor detection not required where sleeping unit doors are equipped with smoke-detector-activated door-closing device

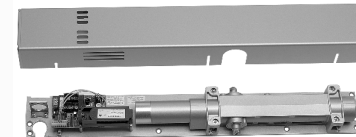


Photo courtesy of
ASSA ABLOY Door Security Solutions



LEARNING
center

148

148

Group I-3 §907.2.6.3.3

- In addition to manual system, smoke detection system is required in housing areas, sleeping units, day rooms and other common spaces accessible to residents
 - Sleeping unit detectors not required in Group I-3 Use Condition 2 or 3
 - Sleeping unit detectors not required in where ≤ 4 residents and the building is sprinklered



LEARNING
center

149

149

Group M §907.2.7

- Manual fire alarm required where:
 - OL ≥ 500
 - ≥ 100 persons are located above or below LED
- Not required in covered or open malls
- In sprinklered buildings, manual fire alarm boxes can be eliminated except for one in an approved location
- Notification signal can go to normally attended location if emergency voice/alarm communication system is provided




LEARNING
center

150

150

Group R-1 §907.2.8.1

- Manual fire alarm system required
- Manual fire alarm system is **NOT** required where:
 - Building is ≤ 2 stories in height
 - Sleeping units, attics & crawl spaces have a minimum 1-HR separation
 - Each individual sleeping unit has an exit directly to a public way, exit court or yard

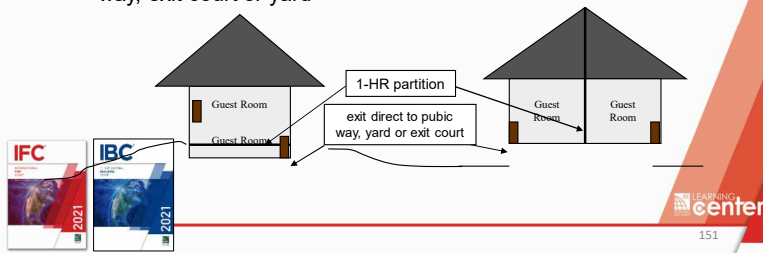

LEARNING
center

151

151

Group R-1 §907.2.8.1, Exc 2

- Manual fire alarm boxes are not required where:
 - Building is sprinklered with NFPA 13 or 13R
 - Notification appliances activate upon sprinkler flow
 - 1 manual fire alarm box is installed at an approved location



LEARNING
center

152

152

152

Group R-1 §907.2.8.2

- Smoke detection required in interior corridors serving sleeping rooms
 - Detection system is not required where the sleeping units have means of egress door opening directly to an exterior exit access




center

153

153

Group R-2 §907.2.9

- Manual fire alarm system required where:
 - Any dwelling unit is ≥ 3 stories above lowest LED
 - Any dwelling unit is located >1 story below the highest LED
 - Building houses >16 dwelling units or sleeping units

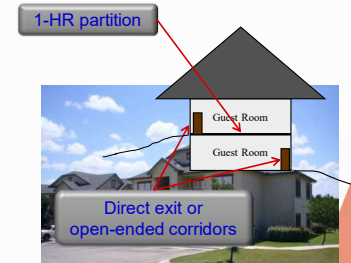

Manual fire alarm system is not required IF 1-HR partition separates all units and each unit has direct exit or exits through open-ended corridors

with NFPA 13 or 13R



center

154

154

Group R-2 College & Univ. Buildings §907.2.9.3

- Smoke detection system is required in Group R-2 occupancies operated by a college or university for student or staff housing
 - Common spaces outside of dwelling and sleeping units
 - Laundry rooms, mechanical equipment rooms and storage rooms
 - Interior corridors serving sleeping or dwelling units

Detection system is not required in buildings without interior corridors

Smoke alarms in dwelling units and sleeping units SHALL be interconnected to fire alarm system



center

155

155

Group R-4 §907.2.10

- Manual fire alarm system is required
- Smoke detection system is required in corridors and kitchen

Manual fire alarm system is not required IF building ≤ 2 -stories with 1-HR partitions separating all units and each unit has direct exit

Smoke detection is not required in buildings sprinklered with NFPA 13

Smoke detection is not required if no interior corridors serving sleeping units and unit has exit to exterior sprinklered with NFPA 13 or 13R



center

156

156

REFER TO

CODE BOOK

2021 IFC
 §202
 Page 2-34

Special Amusement Buildings

A special amusement building represents a high fire and life safety challenge based on its definition:

A building that is temporary, permanent or mobile that contains a device or system that conveys passengers or provides a walkway along, around or over a course in any direction as a form of amusement arranged so that the egress path is not readily apparent due to visual or audio distractions or an intentionally confounded egress path, or is not readily available because of the mode of conveyance through the building or structure.

157

157

Special Amusement Buildings §907.2.11

- Smoke detection system required
 - Activate audible/visual alarms
 - Illuminate the means of egress
 - Shut off sound
 - Shut off visual distractions that confuse occupants
 - Activate approved directional exit marking
 - Activate pre-recorded message on emergency voice/alarm communication system




 

158

158

High-rise Buildings §907.2.12

- Smoke detection required in:
 - Air-handling systems
 - Mechanical equipment rooms
 - Elevator machine rooms
 - Elevator lobbies
- Emergency voice/alarm communication system required
- Emergency responder radio coverage
 - Fire department communication systems

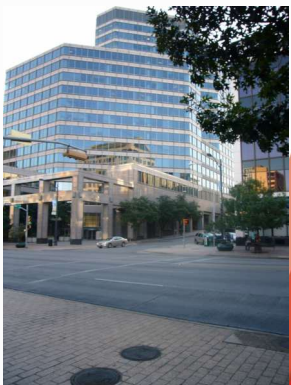

159

159

Emergency Voice/Alarm Communication Systems §907.5.2.2

- System to deliver voice instructions on the floor of fire origin and the floor above and below the floor of fire origin
- Speakers are required to be designed as dedicated paging zones:
 - Elevator groups
 - Exit stairways
 - Each floor
 - Areas of refuge



160

160

Fire Alarm System Zones §907.6.4

- Each floor is zoned separately
 - ≤22,500 ft², except for sprinkler systems
 - ≤300' in any direction
- In high-rise buildings each floor will have separate zones for:
 - Smoke detectors
 - Sprinkler water-flow devices
 - Manual fire alarm boxes
 - Other fire detection or suppression systems



LEARNING center
161

161

Retroactive Fire Alarm Systems §1103.7

- If the following existing buildings do not have a fire alarm system, one must be installed:
 - Groups E, I-1, I-2, I-3, R-2
 - Group R-1 boarding and rooming houses
 - Group R-1 hotel and motel
 - Group R-4 residential care/assisted living facilities.
- Single- and multiple-station smoke alarms in Groups I-1 and R



LEARNING center
162

162

Duct Smoke Detection §907.3.1

- When a fire alarm system is required, all extinguishing and detection systems must be connected to fire alarm system
- IMC §602 requires duct detection when:
 - Return air systems have a capacity >2,000 CFM
 - Common supply and return air systems have a capacity >2,000 CFM
 - Return air risers serving ≥2 stories have a design capacity >15,000 CFM



Photo courtesy of Air Products and Control, Inc.




LEARNING center
163

163

Protection of Fire Alarm Control Unit §907.4.1

- When FACU is located in an area which is not in a continuously occupied area, it must be protected by:
 - A single smoke detector; or
 - A heat detector where ambient conditions are not favorable to smoke detectors
- §907.4.3.1 states that a fire sprinkler can fulfill the service of a heat detector

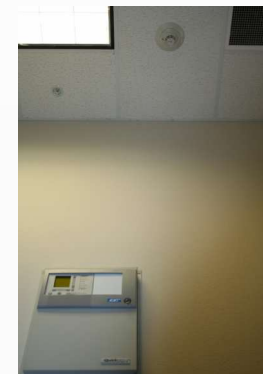

LEARNING center
164

164

164

Manual Fire Alarm Boxes §907.4.2

- Manual fire alarm boxes must:
 - Be located $\leq 5'$ from each exit
 - Have an exit access travel distance to manual fire alarm box of $\leq 200'$
 - Have an activation handle located 42-48" AFF
 - Be **red** in color
 - Be equipped with listed protective covers if ordered by the FCC



LEARNING center

165

165

Occupant Notification Systems §907.5

- Notification appliances are required in most occupancies
 - Audible
 - Visual
 - Tactile
 - Any combination thereof
- Notification must occur upon activation of a fire detector, sprinkler flow, a manual fire alarm box or an automatic fire-extinguishing system



LEARNING center

166

166

Audible Alarms §907.5.2

- 15 dBA above ambient sound level
- Maximum sound pressure level permitted is 110 dBA
- Minimum required sound pressure level for all appliances and for certain areas of buildings



LEARNING center

167

167

Visual Alarms §907.5.2.3.1

- Visual
 - Pl
 - C
 - Sl
 - ur
 - Empl
 - audib
 - notific
 - design
 - capacity for future visual alar

Number of Sleeping Units	
6 to 25	
26 to 50	
51 to 75	
76 to 100	
101 to 150	12
151 to 200	14
201 to 300	17
301 to 400	20
401 to 500	22
501 to 1,000	5% of total
1,001 and over	50 plus 3 for each 100 over 1,000

All dwelling units and sleeping units in Group R-2 shall be provided with the capability to support visible alarm notification appliances



LEARNING center

168

168

Monitoring §907.6.6

- All required fire alarm systems to be monitored by an approved supervising station
- Supervision is not required for:
 - Smoke alarms or smoke detectors in Group I-3
 - Automatic sprinklers in 1- and 2-family dwellings
 - Smoke alarms



Photo courtesy of Property Protection Inc.



LEARNING center

169

169

Inspection, Testing and Maintenance §907.8

- Acceptance testing of fire detection and alarm systems is required at time of installation
- Additional/routine testing in accordance with the schedules in NFPA 72
- Written records of the maintenance, inspection and testing
- Records to be maintained and made available to FCO upon request



LEARNING center


170

170

Where Smoke Alarms Are Required §907.2.10

- Smoke alarms are required in:
 - Groups R-1, R-2, R-3, R-4 and I-1
- In new occupancies,
 - Smoke alarms comply with UL 217
 - Smoke detectors comply with UL 268
- backup power supply
- Interconnection when ≥ 1 device

A single- or multiple-station alarm which responds to smoke and is not connected to a system

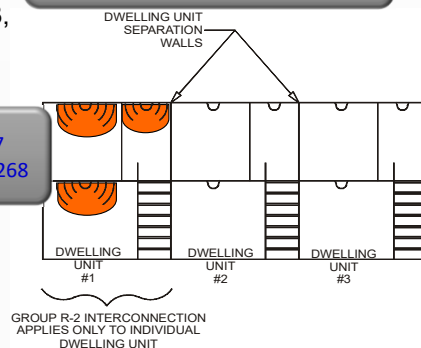


LEARNING center

171

171

Smoke Alarms near Cooking Appliances and Bathrooms - §907.2.10.3, §907.2.10.4

- Criteria for locating smoke alarms in relation to cooking appliances
- Criteria for locating smoke alarms in relation to bathrooms
- Proper location of smoke alarms can help reduce the number of nuisance alarms

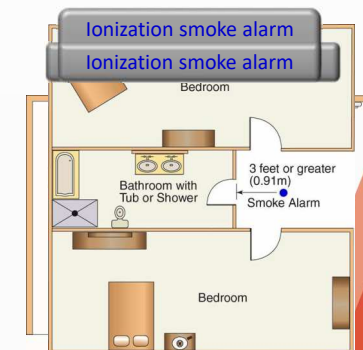

LEARNING center

172

172

Emergency Alarm Systems §908

- Emergency alarm systems required for:
 - Group H-5
 - Indoor storage & use areas of highly toxic or toxic gases as required by §6004.2.2.10
 - Ozone gas-generator rooms
 - Repair garages for vehicles fueled with a nonodorized gas
 - Refrigeration systems



Emergency alarms are systems to provide indication and warning of emergency situations involving hazardous materials




173

173

Carbon Monoxide Alarms §915, §1103.9

- CO alarms required in:
 - Groups I-1, I-2, I-4 and R
 - Group E classrooms
- IF:
 - Fuel-burning appliances
 - Force air furnace with fuel-burning appliance
 - Attached private garage
- Could be combined with fire alarm system



Only retroactive for these occupancies

Public garages are regulated under IBC §406 and provided with ventilation



LEARNING center

174

174



Fire Alarm and Detection Systems

- What is the component in a fire alarm and detection system that recognizes a change of state or condition?

Alarm-initiating device
§902.1

- What IFC chapter contains the retroactive requirements for fire alarm systems?

Chapter 11 Construction Requirements for Existing Buildings
§1103.7



175

175



Fire Alarm and Detection Systems

- Which occupancies/facilities require an emergency alarm/voice communications system?

Cover or open mall >50,000 ft² §914.2.3
Group A with OL >1,000 §907.2.1.2
Group E with OL >100 §907.2.3
Group A, E or M with atrium §907.2.13
High-rise buildings §914.3.5

- CO alarms are required in all rooms of Group E occupancies.

Only in classrooms of Group E
§915.1.1



176

176

Module 7



Smoke Management



LEARNING center

177

Smoke Management Systems §909, §910

- Two concepts of handling smoke in the code
 - §909 – Smoke Control Systems
 - §910 – Smoke and Heat Removal
- These systems are designed to maintain
 - These systems are designed to remove smoke from buildings in large Group F and S occupancies
- Both enhance and protect property
- Smoke Control System's main function is for life safety



LEARNING center

178

Required Smoke Control Systems

- IBC §402.7.2 – covered malls constructed as an atrium >2 stories in height
- IBC §404.5 – atriums
- IBC §405.5 – underground buildings
- IBC §408.9 – windowless buildings
- IBC §410.2.7.2 – stage >1,000 ft²
- §1029.6.2.1 – smoke-protected assembly seating
- §1023.11 – smokeproof enclosures



LEARNING center

179

Types of Smoke Control Systems

- 3 methods of smoke control:
 - Smoke barrier construction – can be either active or passive
 - Pressurization method – provides a differential pressure across smoke barriers. It is permitted in sprinklered buildings.
 - Exhaust method – provides a differential pressure across smoke barriers. It is permitted in sprinklered buildings.
- These systems are engineered for a specific building and specific purpose
- Each system will have distinct components and design
- Systems need to be commissioned and inspected in accordance with the design documents



LEARNING center

180

Smoke and Heat Removal

- Smoke and heat removal required in:
 - Group F-1 and S-1 >50,000 ft²
 - High-piled storage where required by Table 3206.2
- A smoke and heat removal can be accomplished by either:

- Smoke/Heat Vents
 - Mechanical Smoke Removal
- Not required:**
- In frozen food warehouses with Class I or II commodities
 - Where ESFR sprinklers are installed
 - Where CMSA sprinklers with RTI ≤50 are installed



LEARNING center
181

181

Smoke and Heat Removal §910

- Selection of smoke & heat removal method

Method of Smoke & Heat Removal	Sprinklered Building	Nonsprinklered Building	1 st Story with Stories Above
Smoke/Heat Vents	Option 1	Required	Not allowed
Mechanical Smoke Removal	Option 2	Not allowed	Required



LEARNING center
182

182

Smoke/Heat Vents

- Smoke/Heat Vents
 - Design option
- Photo courtesy of Bilco Corporation



LEARNING center
183

183

Smoke and Heat Removal §910

- Smoke/heat vents
 - Calculation for sprinklered building
 - $A_{VR} = V/9000$
 - Calculation for nonsprinklered building
 - NOTE:** formula is based on volume; no longer based on floor area
 - A_{VR} = the aggregate vent area required
 - V = the volume of the area to be vented



LEARNING center
184

184

Smoke/Heat Vents

• Calculation for sprinklered building

- 400,000 ft² warehouse
- Ceiling/roof height = 36'
- $400,000 \times 36 = 14,400,000 \text{ ft}^3$
- $14,400,000 \div 9,000 = 1,600 \text{ ft}^2$ of vent area
- 4' x 8' Smoke/heat vent = 32 ft²
- $1,600 \div 32 = 50$ vents

$$A_{VR} = V \div 9000$$

Photo courtesy of Bilco, Inc.



185

center

185

Smoke and Heat Removal §910

- Mechanical smoke removal
 - 2 air changes per hour
 - Based on empty building
 - Makeup air openings $\leq 6'$ of floor
 - Automatic shutdown upon sprinkler operation
 - Manual controls in room accessible from the exterior with 1-HR separation



186

186

Smoke/Heat Vents

Given:

- Building area: 65,000 ft²
- Storage Height: 21'
- Ceiling Height: 27'
- High-piled Storage: Yes
- Commodity: Class IV
- Area of each smoke and heat vent: 32 ft²
- Building is sprinklered



187

center

187


Smoke/Heat Vents

Determine smoke/heat vent requirements

$$A_{VR} = V \div 9000$$

- Volume = 65,000 X 27
- Volume = 1,755,000 ft³
- $A_{VR} = V \div 9000$
- $A_{VR} = 1,755,000 \div 9000$
- $A_{VR} = 195 \text{ ft}^2$
- Smoke/heat vent = 32 ft²
- $195 \div 32 = 6.09$ vents
- Therefore 7 vents required

Is this design
acceptable?

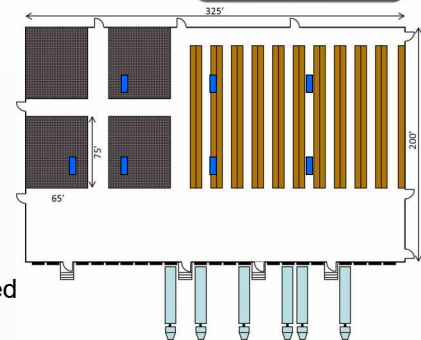

188

center

188

Smoke/Heat Vents §910.3

- Vents listed to UL 793 or FM 4430
- Gravity drop out vents must operate after a 5-minute exposure to temperature of 500°F
- Activation temperature is not specified in the IFC
 - FM specifies that vents should be $\leq 100^\circ\text{F}$ above the sprinkler operating temperature
- Smoke/heat vents $\geq 16\text{ ft}^2$
- Located $\geq 20'$ from property lines and $\geq 10'$ from fire barriers or fire walls



LEARNING center

189

189

Mechanical Smoke Removal

Given:

- Building area: 65,000 ft²
- Storage Height: 21'
- Ceiling Height: 27'
- High-piled Storage: Yes
- Commodity: Class IV
- Exhaust fans rated at 30,000 CFM
- Building is sprinklered



LEARNING center

190


190

Mechanical Smoke Removal

Determine smoke/heat vent requirements

Ventilation = 2 air changes/hour

- Volume = 65,000 X 27
- Volume = 1,755,000 ft³
- CFH = 2 X 1,755,000
- CFH = 3,510,000 ft³
- CFM = 3,510,000 ÷ 60
- CFM = 58,500
- 58,500 ÷ 30,000 = 1.95 fans
- Makeup air = 8 ft² per 1,000 CFM
- 293 ft² required

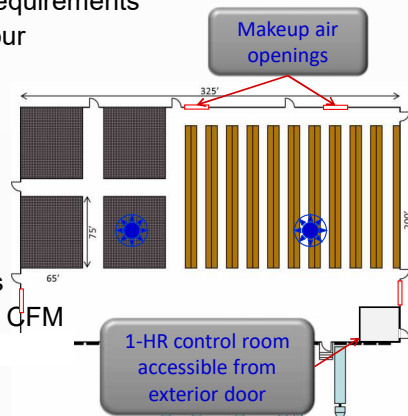

LEARNING center

191

191

191

Discussion Activity



LEARNING center

192

192

192

Final Reflection

Reflect on the day. What will you take back to the job and apply?

- **What?** What happened and what was observed in the training?
- **So what?** What did you learn? What difference did this training make?
- **Now what?** How will you do things differently back on the job as a result of this training?



LEARNING center

193

193

IACET Accreditation



- The International Code Council has been accredited as an Authorized Provider by the International Association for Continuing Education and Training (IACET).
 - As a result of their Authorized Provider accreditation status, ICC is authorized to offer IACET CEUs for its programs that qualify under the ANSI/IACET Standard.
- You will obtain full CEUs for this course, if you actively participate in the training activities and stay for the entire session. Evidence of this will be the sign out sheet.



LEARNING center

194

194

AIA Accreditation



International Code Council is a Registered Provider with The American Institute of Architects Continuing Education Systems. Credit earned on completion of this program will be reported to CES Records for AIA members. Certificates of Completion for non-AIA members are available on request.

This program is registered with the AIA/CES for continuing professional education. As such, it does not include content that may be deemed or construed to be an approval or endorsement by the AIA of any material of construction or any method or manner of handling, using, distributing, or dealing in any material or product. Questions related to specific materials, methods, and services will be addressed at the conclusion of this presentation.



LEARNING center

195

195

Copyright Materials

This presentation is protected by U.S. and International Copyright laws. Reproduction, distribution, display and use of the presentation without written permission of the speaker is prohibited.

© International Code Council 2022



2021 IFC IBC Fire Protection Systems

196

196

Thank you for participating!

To schedule a seminar, contact:

The Learning Center™

1-888-ICC-SAFE (422-7233) Ext. 33821

or

E-mail: learn@iccsafe.org

Website: learn.iccsafe.org



THE LEARNING
center

197

197